


PAVED AREAS

UNPAVED AREAS

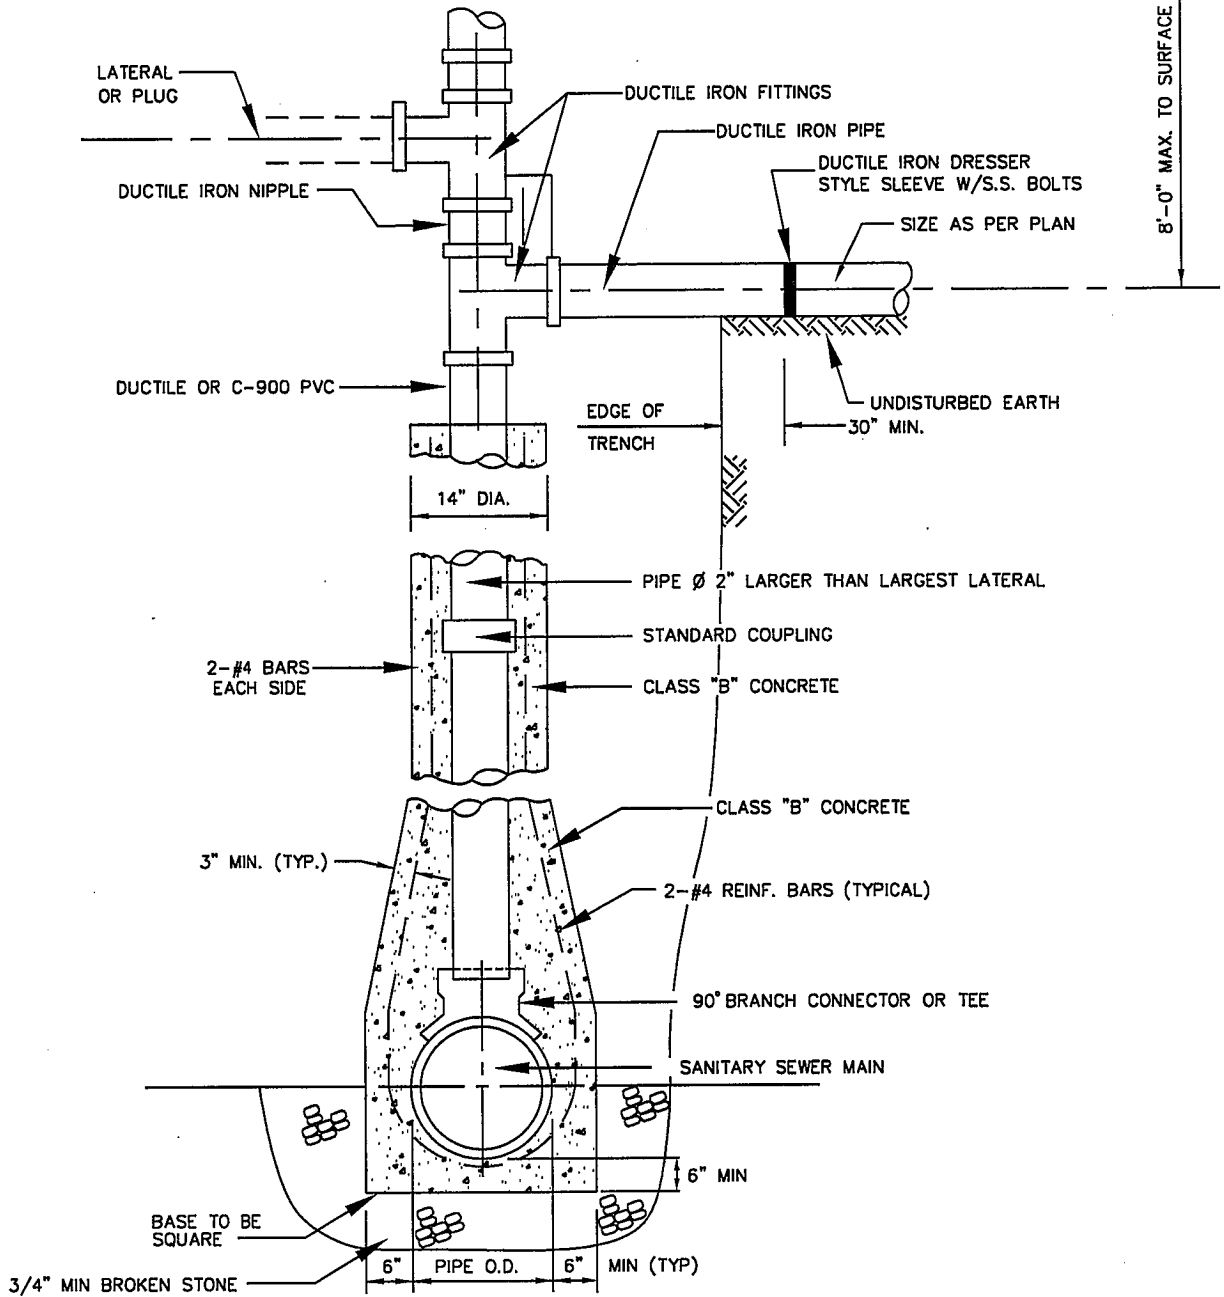

NOTES:

1. DEEP HOUSE SERVICE CONNECTIONS ARE NOT TO BE USED ON MAINS LESS THAN 12 FEET DEEP UNLESS APPROVED BY THE AUTHORITY ENGINEER.
2. THE VERTICAL STACK IS TO BE RAISED TO THE SURFACE AND PROTECTED BY CC-6 BOXES FOR SANITARY SEWERS IN PAVED AREA'S. THE VERTICAL STACKS FOR SANITARY SEWERS IN UNPAVED AREA'S ARE TO REMAIN AT LEAST 4 FEET BELOW THE GROUND SURFACE AND MARKED WITH A CARSONITE POST ABOVE AND BELOW THE GROUND

REVISED 12-13-02 CADD DRAWING BY GTS CONSULTANTS, INC.

DATE: JAN. 1991  
 DRAWN: G.G.&G.T.R.  
 SCALE: NONE

LAKESWOOD TOWNSHIP  
 MUNICIPAL UTILITIES AUTHORITY

DEEP SERVICE  
 CONNECTION