


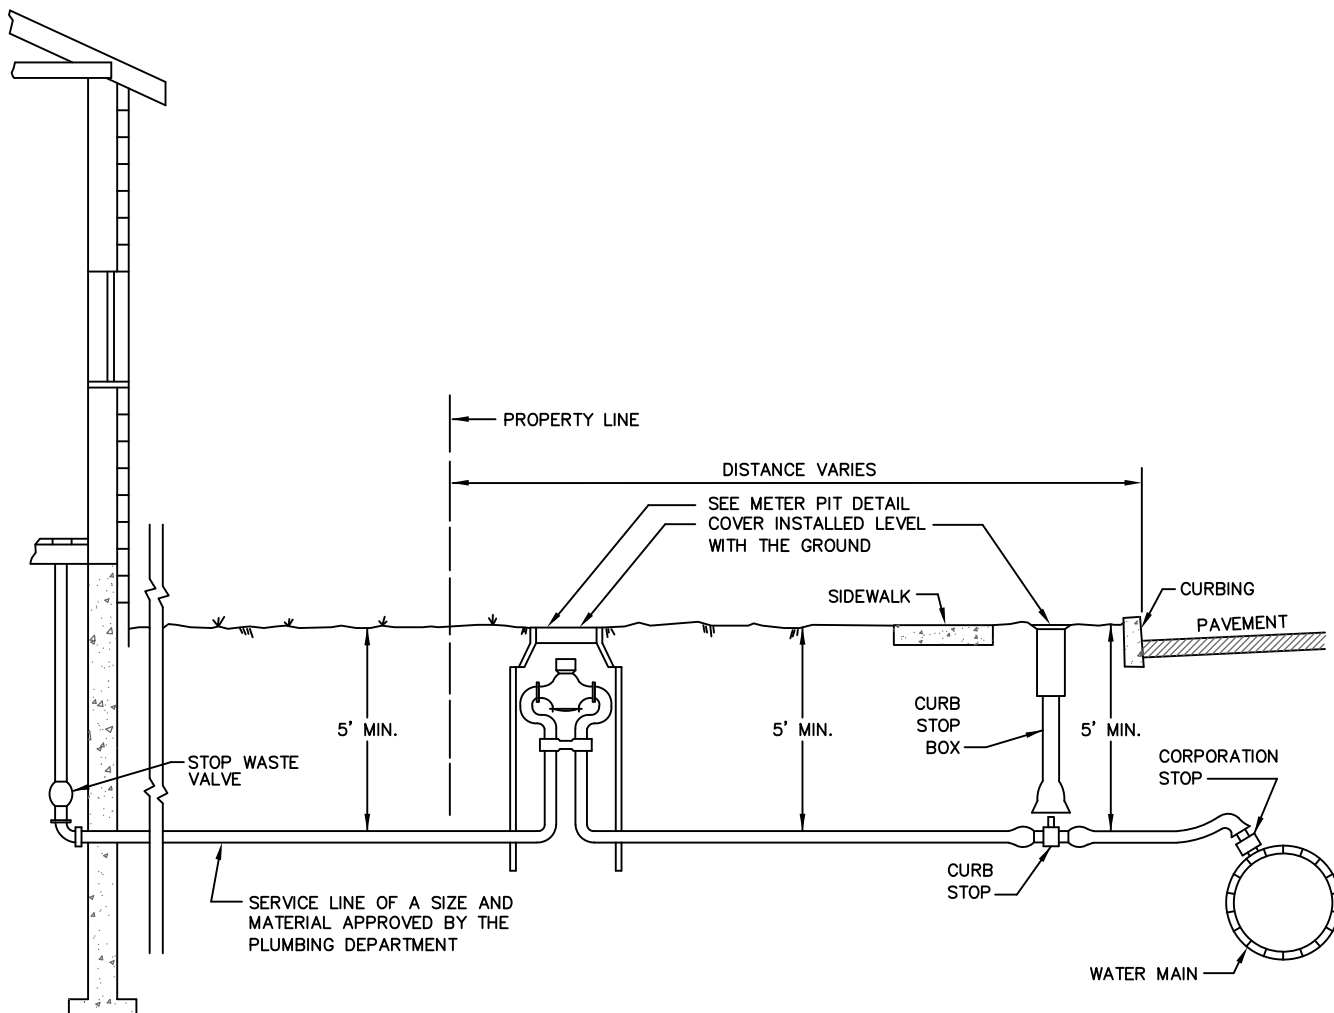

1. PLACEMENT OF METER PIT CAN VARY FROM A MAXIMUM OF 5 FEET OUTSIDE THE PROPERTY LINE TO A MAXIMUM OF 5 FEET INSIDE THE PROPERTY LINE. PLACEMENT OUTSIDE OF THE PROPERTY LINE IS PREFERRED.
2. REFER TO THE NOTES ON THE APPROVED DEVELOPMENT PLAN(S) FOR THE DETERMINATION OF THE SERVICE LINE OWNERSHIP LIMITS.
3. SEE SERVICE CONNECTION DETAIL FOR INFORMATION REGARDING MATERIALS.
4. SHOULD A SITUATION ARISE OTHER THAN SHOWN CONCERNING THE DEPTH OBSTRUCTION OF SERVICE LINE OR THE PLACEMENT OF METER PIT OR CURB BOX, CALL THE AUTHORITY IMMEDIATELY FOR DIRECTION.
5. THE CONTRACTOR IS RESPONSIBLE FOR NOTIFYING THE AUTHORITY AND THE TOWNSHIP PLUMBING DEPARTMENT FOR INSPECTION AT LEAST 48 HOURS IN ADVANCE OF THE WORK BEING PERFORMED.
6. IF THE INSPECTOR FOR THE AUTHORITY IS NOT PRESENT AT THE TIME OF THE INSTALLATION, THE TRENCH MUST REMAIN OPEN UNTIL THE SERVICE LINE IS INSPECTED BY AN AUTHORIZED REPRESENTATIVE OF THE AUTHORITY. NO TRENCH SHALL REMAIN OPEN OVERNIGHT.
7. CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL PERMITS.
8. SERVICE LINE MUST BE A MINIMUM OF 1" DIAMETER OF TYPE "K" COPPER FROM THE WATER MAIN TO, THROUGH AND TO THE OUTSIDE WALL OF THE METER PIT.

REVISED 6-15-26	GENERAL REVISIONS BY GTS CONSULTANTS
REVISED 4-5-18	GENERAL REVISIONS BY GTS CONSULTANTS
REVISED 10-8-03	CADD DRAWING BY GTS CONSULTANTS, INC.

DATE: JAN. 1991
 DRAWN: G.G. & J.T.R.
 SCALE: NONE

**LAKEWOOD TOWNSHIP
 MUNICIPAL UTILITIES AUTHORITY**

**SERVICE LINE WITH
 METER PIT DETAIL**